


EXPANSION JOINT VARIATIONS

1/2" RUBBERIZED EXPANSION JOINT FILLER

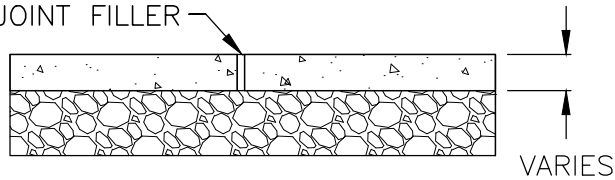

DETAIL OF EXPANSION JOINT

GENERAL NOTES

1. ALSO SEE SIDEWALK DETAILS
2. 1" JOINTS TO BE PLACED WHERE THE SIDEWALK IS IN CONTACT WITH CIRCULAR CURB, BUILDINGS AND RETAINING WALLS. 1/2" JOINTS TO BE USED AT OTHER LOCATIONS.
3. ONE LONGITUDINAL JOINT MARKING REQUIRED ON SIDEWALK OVER 5' IN WIDTH TO LESS THAN 10'. TWO LONGITUDINAL JOINTS FOR TRAIL 10' TO 12'.

N.T.S

CITY OF FRANKLIN

TYPICAL SIDEWALK/TRAIL EXPANSION JOINT

Paul P. Hoyle 7/1/2017
CITY ENGINEER DATE

DWG. NO. RP-10

EFFECTIVE DATE: 7/1/2017

Stephanie M. Martin 7/1/2017
ASST. DIRECTOR OF ENG. DATE